

LAB TESTING REPORT

Material: **CARPET TILE**

Factory: NEWSPEC

File Number: 2018042004

Date: 4/4/2018


Dimension: 600*600mm

Test Item	Standard Designation	Result	Requirement	Passed/Failed
DIMENSIONAL STABILITY OF PILE YARN FLOOR COVERING	ASTM D7570-09	Parallel: <u>-0.023%</u> Perpendicular: <u>-0.026%</u>	≤0.2%	PASS
TUFT BIND	ASTM D1335-12	<u>32.7 N</u>	≥30 N	PASS
PILL TEST	ISO 6925	<u>10.09 mm</u>	≤76.20mm	PASS
HEXAPOD TEST	ASTM D5252	<u>3.5</u>	≥2.5	PASS

QUALITY • ASSURANCE • VERITAS

LAB TESTING REPORT

TEST PHOTO

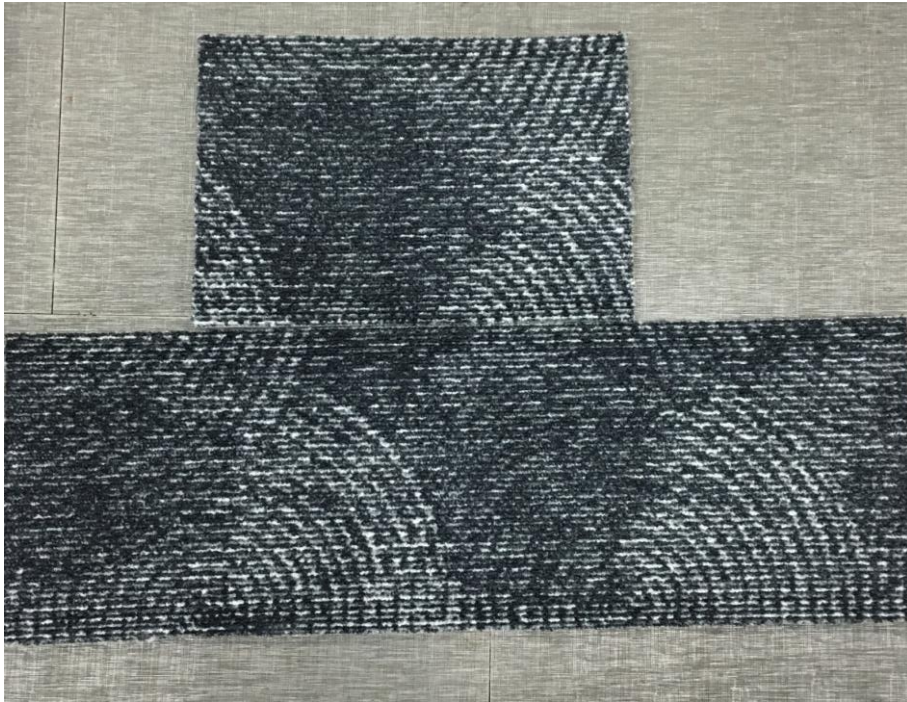

QUALITY • ASSURANCE • VERITAS

Operator: Amy, Ashkan, Leo

Date: 2018/4/20